



# JFS-PS1000(E)

## REMOTE POWER SUPPLY



P/N See Chart

### Features

- 10 Amp Power Supply
- 3 Amps, regulated per NAC
- 6 NACs Class B or 3 NACs Class A
- 2 dry contact inputs
- Fully programmable and monitored through control panel
- Isolated P-Link repeater connection, Class A or B
- Up to 31 power supplies per control panel with system wide sync
- 120/240 VAC Input at 50/60 HZ
- 5.1 Amps/3.0 Amps max draw
- Standby Current 60 mA
- Alarm Current 200 mA
- Quadrasync feature synchronizes strobes from Potter/AMSECO, Gentex, Cooper-Wheelock and System Sensor.
- For JFS-IP Series and JFS-A Series Addressable Control Panels

### Description

The JFS-PS1000 series is a UL listed intelligent 10 amp notification power supply and P-Link (RS-485) repeater. The power supply connects to the P-Link bus from the control panel and is operated and supervised from the panel. The power supply may be installed 6,500 feet from the control panel. The JFS-PS1000 then repeats the P-Link communication for another 6,500 feet.

The power supply has six (6) Class B or three (3) Class A power outputs. Each output is regulated and power limited with a 3 Amp maximum rating. In addition, the JFS-PS1000 has two (2) programmable dry contact inputs. The dry contact inputs are Class B, supervised inputs.

The power supply operates on either 120 or 220 VAC power and has a regulated 24 VDC output. In addition, the panel can charge up to 55 AH batteries and will house 8 AH or 18 AH batteries<sup>1</sup>. The cabinet is constructed out of 18 gauge cold rolled steel with a durable red powder coat finish. A standard Potter key lock is provided for securing the door. Electrical conduit knockouts are provided on the sides and top providing installers with multiple options for installing conduits and providing proper power separations.

The JFS-PS1000 is a self contained intelligent power supply/P-Link repeater complete with cabinet. The JFS-PS1000E is the intelligent power supply/P-Link repeater with additional cabinet room for the exclusive Stacker Bracket for SLCE-127 loop expanders. Both cabinets include space for 18 AH batteries.


The power supplies are programmed and controlled through the main control panel P-Link bus. The panel displays any troubles or off normal conditions of the power supply and the events are stored in the panel history buffer.

Each output can be independently configured to provide one of four synchronization patterns, constant power, ANSI temporal Code 3 or Door Holder power. The panel can be configured to synchronize Potter/AMSECO®, Gentex®, Cooper Wheelock® and System Sensor®.

<sup>1</sup> 12 AH Batteries will not fit in JFS-PS1000 or JFS-PS1000E cabinet. Use 18AH batteries where 12 AH are required.



## Dimensions

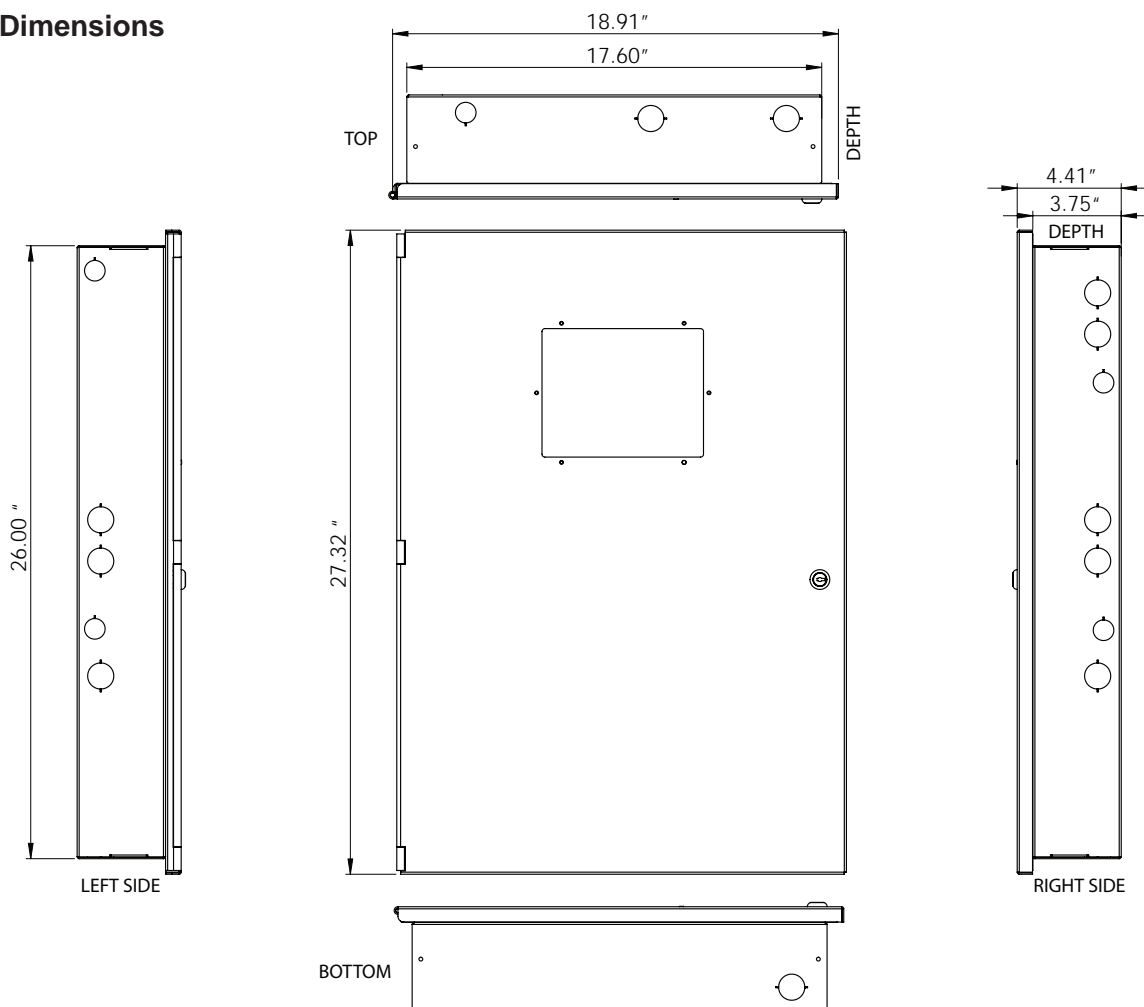

### Ordering Information

Model Number	Description	P/N
JFS-PS1000	Power Supply, Remote, Intelligent, JFS-A1/JFS-A2	98802
JFS-PS1000E	Power Supply, Remote, Intelligent, JFS-A2 (w/ room for SLCE-127)	98728
N/A	Board, Replacement, Left, for JFS-PS1000(E)	98257
N/A	Board, Replacement, Right, for JFS-PS1000(E)	98256
EOLD 3005012 <sup>1</sup>	EOL Resistor/Diode Assembly for Releasing Circuit	18712 <sup>1</sup>

<sup>1</sup> For releasing use, EOLD 3005012 must be ordered separately.

*Note: Approvals/Listings maintained by and manufactured by Potter Electric Signal Company.*

The seller makes no warranties, express or implied, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose, except as expressly stated in the seller's sales contract or sales acknowledgment form. Every attempt is made to keep our product information up-to-date and accurate. All specific applications cannot be covered, nor can all requirements be anticipated. All specifications are subject to change without notice.



1102 Rupcich Drive  
 Millennium Park  
 Crown Point, IN 46307  
 TEL: (219) 663-1600 FAX: (219) 663-4562  
 e-mail: [info@janusfiresystems.com](mailto:info@janusfiresystems.com)  
[www.janusfiresystems.com](http://www.janusfiresystems.com)