




PAD200-DUCTR

ANALOG ADDRESSABLE DUCT DETECTOR



0328-0531

0328-0505

P/N 95974

Features

- Detects smoke in building HVAC ducts
- Ships complete with housing and detector
- Compatible with addressable JFS-IP series panels
- SLC Class A, Class X & Class B
- Installation without removing the detector head
- Listed Air Velocity of 100 to 4,000 ft/minute
- No screens or filters in housing
- Durable plastic enclosure and clear cover
- Integrated cover tamper switch
- Utilizes simple snap in sampling tubes STN series
- One form C relay
- Compatible with supervised PAD100-DRTS remote test switch, MS-RA and MS-KA/P/R remote indicators
- UUKL Listed for Smoke Control

Specifications

Operating Voltage: 24 VDC
 Current Draw: 500 μ A
 Detector Head Model: PAD200-DD
 Detector Head Type: Photoelectric
 Alarm Set Point: Fixed at 2.5%/ft
 Sensitivity Test Method: Self diagnostic test
 Air Velocity: 100 to 4000 ft./min
 Ambient Temperature: 32°F to 120°F (0°C to 49°C)
 Humidity: 10% to 85% Relative humidity (noncondensing)
 Housing Material: Plastic backbox, clear plastic cover
 Finish: Gray backbox with clear cover
 Dimensions: 13.5" x 4.5" x 2.25" (343 mm x 114 mm x 57 mm)
 Maximum Net Weight: 2 lbs.
 Sampling Tubes: 2.5 ft., 5 ft., or 10 ft.
 RelayContactRating: 8A@30VDC, 10A@120VAC, 10A@250VAC

Description

The PAD200-DUCTR is designed and built to meet all local requirements, as well as the NFPA regulations regarding duct smoke detectors. Air sampling is accomplished by two tubes which protrude into the duct. An exhaust tube of one standard length (7") is supplied in the installation kit with the smoke duct unit. Once the duct width has been determined the air intake sampling tubes must be ordered. Sampling tubes are supplied in three standard lengths: 2.5 ft., 5 ft., and 10 ft. and cut to size to fit the duct. Mounting the duct smoke unit is accomplished by the use of a template and 2 sheet metal screws, which are provided. Mounting can be achieved without the removal of the clear cover which is secured by 4 capture screws.

Application

The PAD200-DUCTR duct smoke detector provides early detection of smoke and products of combustion present in air moving through HVAC ducts in commercial, industrial and residential applications. The PAD200-DUCTR is compatible with the JFS-IP series addressable fire alarm control panels.




Engineering Specifications


Air duct smoke detectors shall be PAD200-DUCTR Series. The detectors shall be listed by Underwriters Laboratories per UL 268A. The detectors shall operate at air velocities from 100 feet per minute to 4000 feet per minute. The duct detector housings shall be of plastic construction and complete mechanical installation may be performed without removal of detector cover. Visual indication of alarm and power must be provided on detector front. Detector heads shall not require additional filters or screens which must be maintained. The housing shall contain a detector base and PAD200-DD duct smoke detector head. Terminal connections shall be of the screw type and be a minimum of # 12 screw. All wiring must comply with local codes and regulations. Detector shall use the STN series of sampling tubes.

Wiring Diagram

PAD100-DRTS Wiring

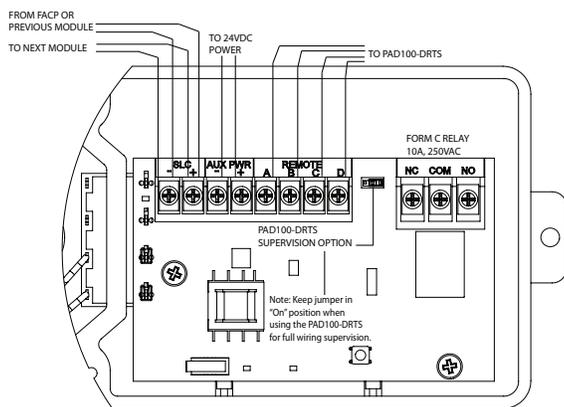

MS-KA/P/R Wiring

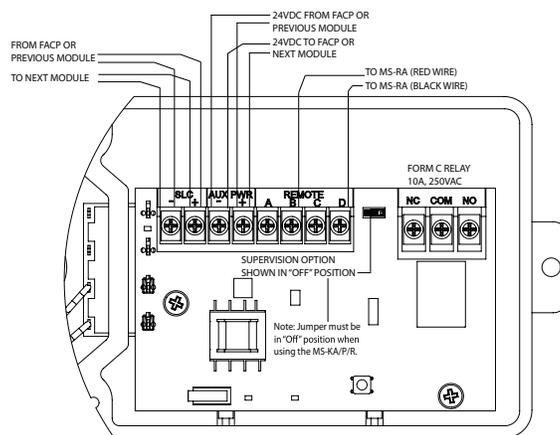

Ordering Information		
Model Number	Description	P/N
PAD200-DUCTR	Analog Addressable Relay Duct Detector	95974
PAD100-DRTS	Duct Remote Test Switch	97678
MS-RA	Remote Annunciator	99755
MS-KA/P/R	Remote Annunciator with Test Switch	97646
STN-2.5	2.5' Sampling Tube	97650
STN-5	5' Sampling Tube	97649
STN-10	10' Sampling Tube	97648

Note: Approvals/Listings maintained by and manufactured by Potter Electric Signal Company.

The seller makes no warranties, express or implied, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose, except as expressly stated in the seller's sales contract or sales acknowledgment form. Every attempt is made to keep our product information up-to-date and accurate. All specific applications cannot be covered, nor can all requirements be anticipated. All specifications are subject to change without notice.



1102 Rupcich Drive
 Millennium Park
 Crown Point, IN 46307
 TEL: (219) 663-1600 FAX: (219) 663-4562
 e-mail: info@janusfiresystems.com
 www.janusfiresystems.com